



## SUBMITTAL DATA

## UNIX Ultra 19 Seer 48KBTU

**Model: TUD48-R32AHEDU/ TU48-R32WEDU**

Job Name

Purchaser

Submitted to

Unit Designation


Location

Date

Engineer

For

Schedule No.



TUD48-R32AHEDU



TU48-R32WEDU

### GENERAL FEATURES:

- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- 8 Speed Fan Motor
- Matched with Tosot Indoor Units
- Designed for New Construction or Replacement Market
- Compact and Quiet, as low as 56 dB(A) Side Discharge outdoor unit
- Cooling down to -15°C (5°F)
- Heating down to -30°C (-22°F)
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion
- Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)




## SPECIFICATIONS & FUNCTIONS:

Air Handler			TUD48-R32AHEDU			Product Model			TU48-R32WEDU		
Power Supply	V~/Phases/Hz	208~230/1/60	Power Supply	VAC/Phase/Hz	208~230/1/60	Power Supply	VAC/Phase/Hz	208~230/1/60	Power Supply	VAC/Phase/Hz	208~230/1/60
Air Flow Volume	CFM	1200	Cooling Capacity	Btu/h	48000	Cooling Capacity	Btu/h	48000	Heating Capacity	Btu/h	48000
External Static Pressure	W.C.	0.5	Heating Capacity	Btu/h	48000	EER	(Btu/h)/W	12	COP	(Btu/h)/W	11.6
External Static Pressure Range	W.C.	0~1	EER	(Btu/h)/W	12	SEER	-	19	HSPF	-	10.0
Sound Pressure Level	dB	52	COP	(Btu/h)/W	11.6	Air Flow Volume	CFM	4000	Sound Pressure Level	dB(A)	55
Rated Voltage	V	208/230	SEER	-	19	MOCP	A	45	MCA	A	39.9
Rated Frequency	Hz	60	HSPF	-	10.0	Compressor Model	-	QXAT-F400zN450	Compressor Type	-	Inverter Rotary
Phases	-	1	Air Flow Volume	CFM	4000	Compressor Refrigerant Oil Type	-	FW68DA(FW68L)	Compressor Refrigerant Oil Charge Volume	L	1.5
Fuse Current	A	3.15	Sound Pressure Level	dB(A)	55	Condenser Material	-	Inner Groove Copper Tube-Aluminum fin	Condenser Face Area	sq.ft	11.41
Circuit Breaker	A	15	MOCP	A	45	Condenser Pipe Diameter	inch	φ0.28	Condenser Number of Rows	-	3
Output of Heater	W	6000/9000/12000	MCA	A	39.9	Condenser Tube Pitch(a)×Row Pitch(b)	inch	0.87×0.75	Condenser Fin Pitch	inch	0.059
MOCP	A	15	Compressor Model	-	QXAT-F400zN450	Condenser Fins per Inch (FPI)	-	17	Condenser Number of Circuits	-	12
Motor Full Load Amp(FLA)	A	5.50	Compressor Type	-	Inverter Rotary	Condenser L×H×W	inch	39.5×36.4×2.3	Cooling Temperature Range	°F	5~129.2
Fan Motor Drive Type	-	Direct-driven	Compressor Refrigerant Oil Type	-	FW68DA(FW68L)	Cooling Temperature Range	°F	5~129.2	Heating Temperature Range	°F	-22~75.2
Fan Motor Speed	rpm	950	Compressor Refrigerant Oil Charge Volume	L	1.5	Defrosting Method	-	Automatic Defrosting	Refrigerant Charge-R32	oz	162.3
Fan Motor Power Output	HP	1	Condenser Material	-	Inner Groove Copper Tube-Aluminum fin	Dimension of Outline(W×D×H)	inch	35.4×13.4×49.6	Dimension of Package(L×W×H)	inch	40.7×17.4×55.3
Evaporator Material	-	Inner groove copper tube-Aluminum fin	Condenser Face Area	sq.ft	11.41	Net Weight	lbs	241.4	Gross Weight	lbs	263.5
Evaporator Face Area	sq.ft	5.49	Condenser Pipe Diameter	inch	φ0.28	Connection Pipe Length	ft	24.6	Not Additional Gas Connection Pipe Length	ft	31.2
Evaporator Pipe Diameter	inch	0.37	Condenser Number of Rows	-	3	Connection Pipe Gas Additional Charge	oz/ft	0.215	Line Set Size (Liquid - Gas)	inch	3/8"-3/4"
Evaporator Number of Rows	-	4	Condenser Tube Pitch(a)×Row Pitch(b)	inch	0.87×0.75	Line Set Size (Liquid - Gas)	inch	3/8"-3/4"	Connection Pipe Max. Distance H×L	ft	49.2×98.4
Evaporator Tube Pitch×Row Pitch	inch	1.0×0.87	Condenser Fin Pitch	inch	0.059	Connection Pipe Max. Distance H×L	ft	49.2×98.4			
Evaporator Fin Pitch	inch	0.071	Condenser Fins per Inch (FPI)	-	17						
Evaporator Number of Circuits	-	12	Condenser Number of Circuits	-	12						
Evaporator L×H×W	inch	16.3×24×3.5	Condenser L×H×W	inch	39.5×36.4×2.3						
Evaporator Max. Allowable Pressure	MPa	12.7	Cooling Temperature Range	°F	5~129.2						
Air Filter	-	Metal	Heating Temperature Range	°F	-22~75.2						
Air Filter Size L×W/NO.	inch	23.0×20.3/1	Defrosting Method	-	Automatic Defrosting						
Air Filter Size (Thickness)	inch	0.6	Refrigerant Charge-R32	oz	162.3						
Drainage Connection Size	inch	φ1×0.05	Dimension of Outline(W×D×H)	inch	35.4×13.4×49.6						
Cooling Temperature Range	°F	64.4~89.6	Dimension of Package(L×W×H)	inch	40.7×17.4×55.3						
Heating Temperature Range	°F	50~80.6	Net Weight	lbs	241.4						
Refrigerant	-	R32	Gross Weight	lbs	263.5						
Dimension of Outline(W×D×H)	inch	24.8×21.26×51.97	Connection Pipe Length	ft	24.6						
Dimension of Package(L×W×H)	inch	27.28×25.98×54.8	Not Additional Gas Connection Pipe Length	ft	31.2						
Net Weight	lbs	199.5	Connection Pipe Gas Additional Charge	oz/ft	0.215						
Gross Weight	lbs	218.3	Line Set Size (Liquid - Gas)	inch	3/8"-3/4"						
			Connection Pipe Max. Distance H×L	ft	49.2×98.4						

FAN PERFORMANCE

Static Pressure (Inches W.C.)	0	0.1	0.15	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1
Speed 1 (CFM)	1640	1500										
Speed 2 (CFM)	1680	1560	1500									
Speed 3 (CFM)	1810	1690	1620	1550								
Speed 4 (CFM)	1930	1830	1770	1710	1580	1480						
Speed 5 (CFM)	2200	2110	2040	1980	1860	1720	1620	1490				
Speed 6 (CFM)	2240	2190	2145	2100	2010	1870	1750	1615	1500			
Speed 7 (CFM)	2280	2240	2200	2180	2130	2080	2000	1880	1750	1600		
Speed 8 (CFM)	2300	2260	2220	2190	2140	2090	2040	1980	1930	1800	1700	1550

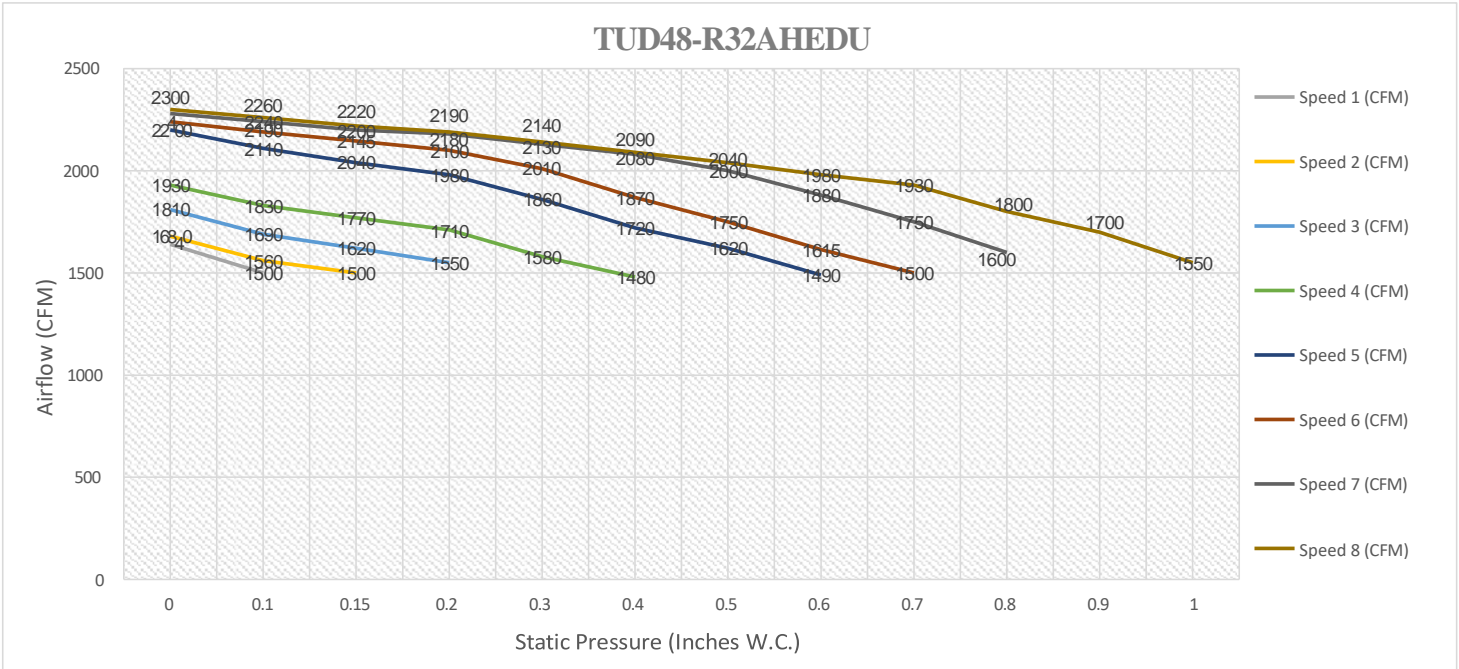

**NOTE:**  
 1. Above chart CFM ratings are based on dry coil with factory filter installed.  
 2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

## DIMENSIONS


### INDOOR UNIT

Unit: inch

TUD48-R32AHEDU	
DIMENSIONS	
A	11-5/8
B	20
H	52
W	24-3/4
D	21-1/4

FILTER SIZE	
Supplied*	20-3/4 x 20-3/8 x 5/8
Suggested	20-3/4 x 20-3/8 x 1


\*Supplied filter is metal mesh

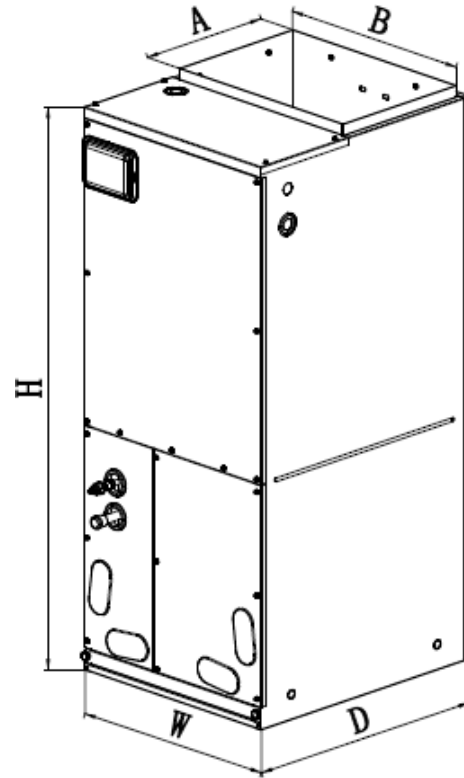


### OUTDOOR UNIT

Unit: inch

TU48-R32WEDU	
DIMENSIONS	
A	37-1/8
B	15-13/16
C	32-1/2
D	22-7/16
E	14-9/16
F	38-1/4
G	14-5/8

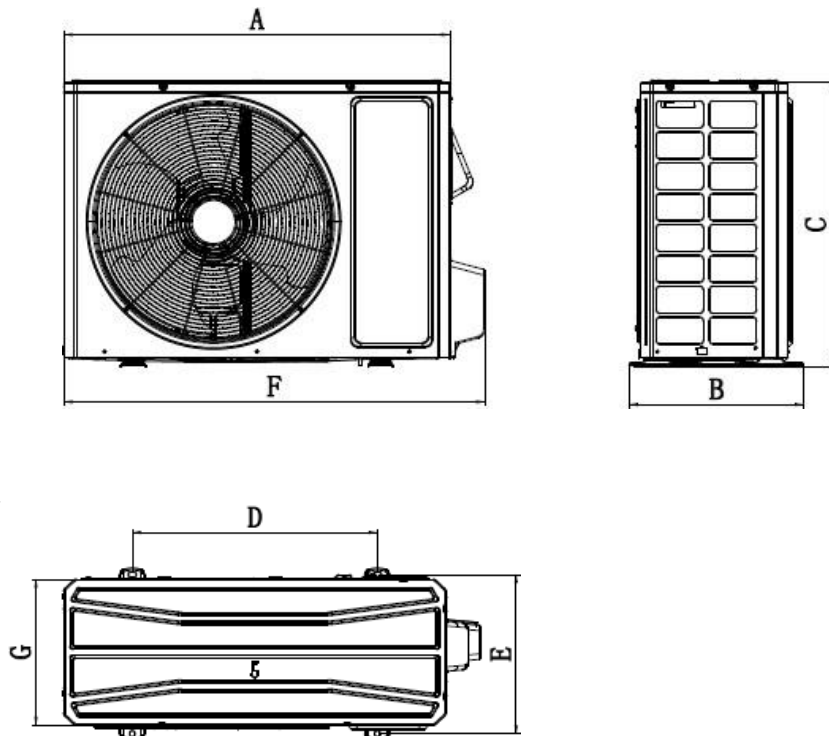

## ACCESSORY HEATER AND GENERAL INFORMATION

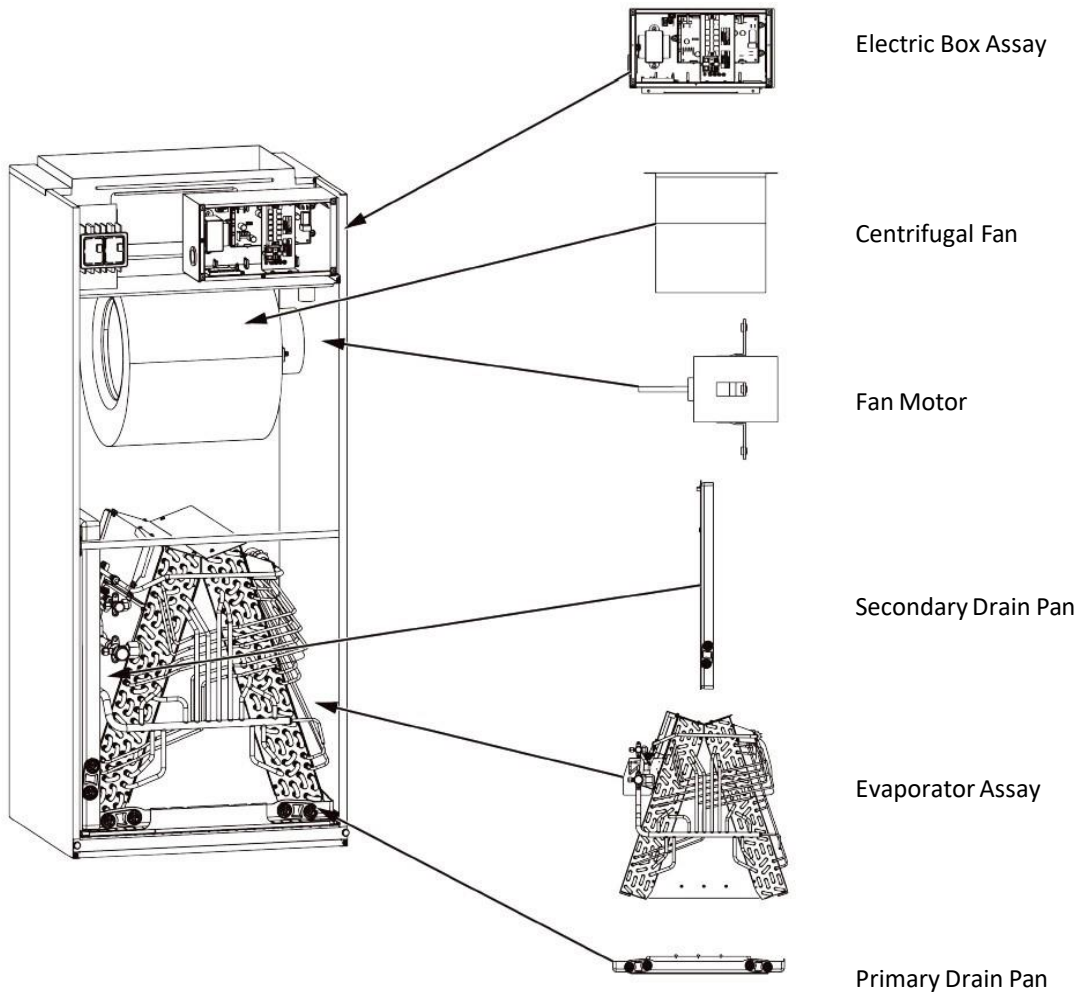

Model	Heat Kit Model	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)								
		208V	230V	208V	230V	208V	230V							
TUD48-R32AHEDU	One Mains Supply													
	ELEMHT16-5KW	3.74	4.6	31	33	35	35							
	ELEMHT16-5KW	6.03	7.36	44	48	45	50							
	ELEMHT16-5KW	7.49	9.2	53	58	60	60							
	Two Mains Supply													
			Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B	Power A	Power B
	ELEMHT16-15KW	7.49	3.74	9.2	4.6	53	23	58	25	60	25	60	30	30
ELEMHT16-20KW	7.49	7.49	9.2	9.2	53	46	58	50	60	50	60	60	60	



## CLEARANCES

### INDOOR UNIT


Minimum clearance

FRONT

> 24

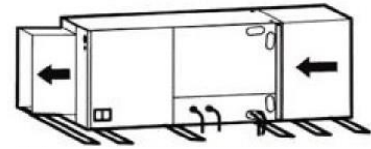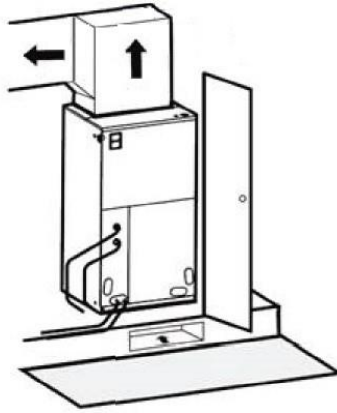

Horizontal Left Configuration - No Modification Needed

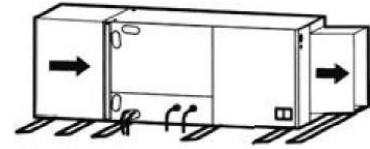

Horizontal Right Configuration - Must Relocate Drain Pan

#### NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

### OUTDOOR UNIT


Minimum clearance

#### NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	$H_b$ $H_d$ $H$		(in)				
			a	b	c	d	e
B	-	-	-	$\geq 4$	-	-	-
A, B, C	-	-	$\geq 12$	$\geq 4$	$\geq 4$	-	-
B, E	-	-	-	$\geq 4$	-	-	$\geq 40$
A, B, C, E	-	-	$\geq 12$	$\geq 6$	$\geq 6$	-	$\geq 40$
D	-	-	-	-	-	$\geq 40$	-
D, E	-	-	-	-	-	$\geq 40$	$\geq 40$
B, D	$H_b < H_d$	$H_d < H$	-	$\geq 4$	-	$\geq 40$	-
	$H_b > H_d$	$H_d > H$	-	$\geq 4$	-	$\geq 40$	-
B, D, E	$H_b < H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 80$	$\geq 40$
		$1/2H < H_d \leq H$	-	$\geq 10$	-	$\geq 80$	$\geq 40$
	$H_b > H_d$	$H_d > H$	Prohibited				
		$H_d \leq 1/2H$	-	$\geq 4$	-	$\geq 80$	$\geq 40$
$H_b > H_d$	$1/2H < H_d \leq H$	-	$\geq 8$	-	$\geq 80$	$\geq 40$	
	$H_d > H$	Prohibited					

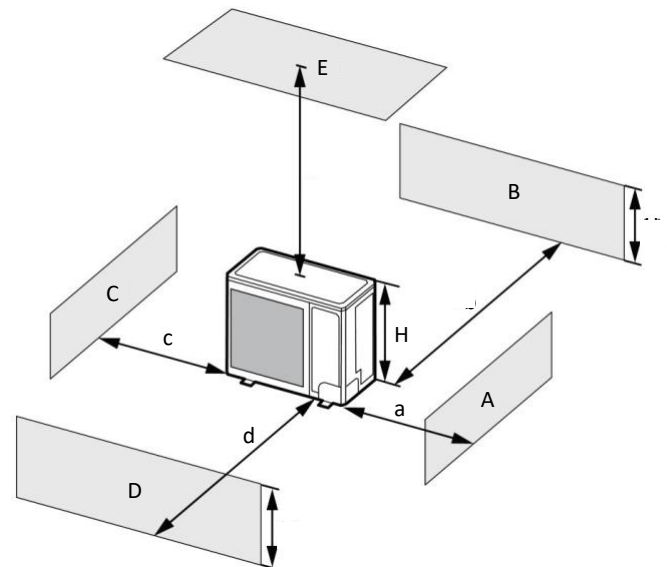

## CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	$H_b$ $H_d$ H	a	b	c	d	e	
A, B, C	-	$\geq 12$	$\geq 12$	$\geq 40$	-	-	
A, B, C, E	-	$\geq 12$	$\geq 12$	$\geq 40$	-	$\geq 40$	
D	-	-	-	-	$\geq 80$	-	
D, E	-	-	-	-	$\geq 80$	$\geq 40$	
B, D	$H_b < H_d$ $H_d > H$	-	$\geq 12$	-	$\geq 80$	-	
B, D, E	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 80$	
		$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 100$	
	$H_b < H_d$	$H_d \leq 1/2H$	-	$\geq 12$	-	$\geq 80$	$\geq 40$
		$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 100$	$\geq 40$
B, D, E	$H_b > H_d$	$H_d > H$	Prohibited			-	
		$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 100$	$\geq 40$
	$H_d > H$	Prohibited			-	$\geq 40$	

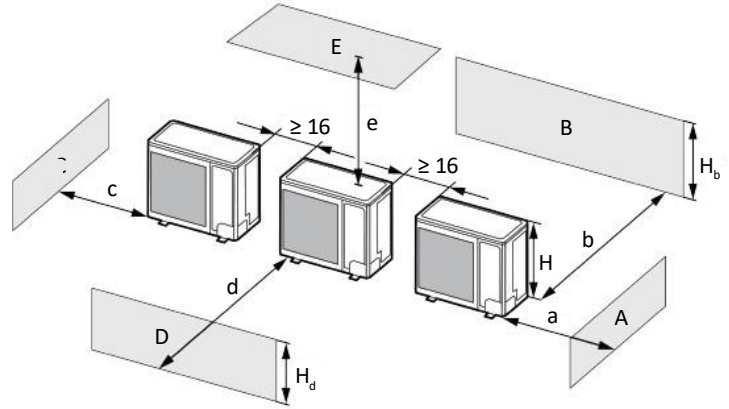

3. When outdoor units are installed in rows.

$H_b$ $H_d$	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

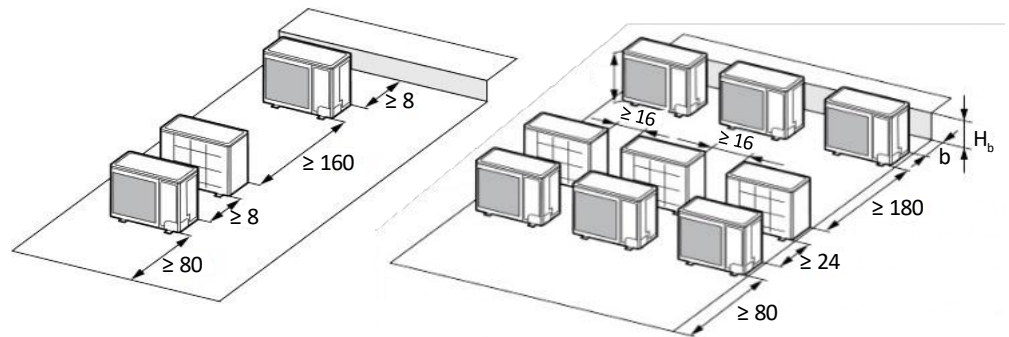

4. When outdoor units are installed one above another.

