



MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Ability Windows Corp.
1350 Park Central Blvd. S.
Pompano Beach, FL 33064

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "910" Aluminum Single Hung Window - N.I.

APPROVAL DOCUMENT: Drawing No. **W06-35**, titled "Series 910 Aluminum Single Hung Wdw. (N.I.)", sheets 1 through 4 of 4, dated 05/09/06, with revision **F** dated 10/05/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 23-0612.03** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




6/16/25

NOA No. 25-0603.02
Expiration Date: April 12, 2028
Approval Date: June 26, 2025
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA's No. 03-1020.01 and 00-0919.04)
2. Drawing No **W06-35**, titled "Series 910 Aluminum Single Hung Wdw. (N.I.)", sheets 1 through 4 of 4, dated 05/09/06, with revision E dated 06/07/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0612.03)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of one specimen of 53-1/8" wide x 63" high aluminum single hung window with spring loaded sill locks, prepared by American Test Lab of South Florida. Test Report No. **ATLSF-1219.01-16**, dated 04/13/18, revision #1, signed and sealed by Stephen Warter, P.E.
(Submitted under NOA No. 18-0314.09)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of one specimen of 53-1/8" wide x 76-3/4" high aluminum single hung window with spring loaded sill locks, prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-3954**, dated 10/08/03, signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No. 03-1020.01)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
along with marked-up drawings and installation diagram of three specimens of 54" wide x 90" high aluminum single hung windows, prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-2551**, dated 02/21/2000, signed and sealed by Aldo P. Gonzalez, P.E.
(Submitted under NOA No. 00-0919.04)


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0603.02
Expiration Date: April 12, 2028
Approval Date: June 26, 2025

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

4. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a 37" wide x 63" high aluminum single hung window with 1/8" annealed glass, prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-2552**, dated 02/16/2000, signed and sealed by Aldo P. Gonzalez, P.E.
(Submitted under NOA No. 00-0919.04)
5. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a 53-1/8" wide x 76-3/4" high aluminum single hung window with 3/16" ann. glass, prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-2586**, dated 02/21/2000, signed and sealed by Aldo P. Gonzalez, P.E.
(Submitted under NOA No. 00-0919.04)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC 6th Edition (2017), dated 05/14/18 and updated on 07/31/20 to comply with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 20-0910.08)
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE


1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, with **FBC 8th Edition (2023)** and of no financial interest, dated January 09, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 23-0612.03)
2. Letter from manufacturer requesting a 1-year extension to allow time to complete the ongoing verification test, dated 04/20/17, signed by Maria Altamuro.
(Submitted under NOA No. 18-0314.09)

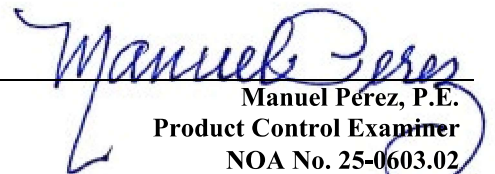
Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0603.02
Expiration Date: April 12, 2028
Approval Date: June 26, 2025

Ability Windows Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

F. STATEMENTS (CONTINUED)

3. Letter of request for a 1-year extension to allow time to perform verification test, dated 09/29/15, issued on behalf of the manufacturer by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
(Submitted under NOA No. 15-1027.05)
4. Testing agreement letter, dated 10/16/15 between American Test Lab of South Florida (ATI) and Ability Windows LLC, to perform verification test to renew their Series "910" Aluminum Single Hung Window – N.I., issued by ATI and signed by Tony Porcello, President.
(Submitted under NOA No. 15-1027.05)
5. Laboratory compliance letter for Test Report No. **FTL-3954**, issued by Fenestration Testing Laboratory, Inc., dated 10/08/03, signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No. 03-1020.01)
6. Laboratory compliance letter for Test Reports No. **FTL-2551** dated 02/21/00, **FTL-2552** dated 02/16/00, and **FTL-2586** dated 02/21/00, all issued by Fenestration Testing Laboratory, Inc., all signed and sealed by Aldo P. Gonzalez, P.E.
(Submitted under NOA No. 00-0919.04)

G. OTHERS

1. Notice of Acceptance No. **23-0117.03**, issued to Ability Windows Corp. for their Series "910" Aluminum Single Hung Window - N.I., approved on 02/09/23 and expiring on 04/12/28.


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0603.02
Expiration Date: April 12, 2028
Approval Date: June 26, 2025

Ability Windows Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No **W06-35**, titled “Series 910 Aluminum Single Hung Wdw. (N.I.)”, sheets 1 through 4 of 4, dated 05/09/06, with revision **F** dated 10/05/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8^h Edition (2023)** and of no financial interest, dated June 3, 2025, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

G. OTHERS

1. Notice of Acceptance No. **23-0612.03**, issued to Ability Windows Corp. for their Series “910” Aluminum Single Hung Window - N.I., approved on 06/29/23 and expiring on 04/12/28.



Manuel Pérez, P.E.
Product Control Examiner
NOA No. 25-0603.02
Expiration Date: April 12, 2028
Approval Date: June 26, 2025

DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.	GLASS TYPE 'A'	GLASS TYPE 'B'	GLASS TYPE 'C'	
HEIGHT	EXT.(+)	INT.(+)	EXT.(+)	INT.(+)
19'-1/8"	48.2	72.0	48.2	72.0
26'-1/2"	48.2	72.0	48.2	72.0
37"	48.2	72.0	48.2	72.0
45"	48.2	72.0	48.2	72.0
53'-1/8"	48.2	72.0	48.2	72.0
19'-1/8"	48.2	72.0	48.2	72.0
26'-1/2"	48.2	72.0	48.2	72.0
37"	48.2	72.0	48.2	72.0
45"	48.2	72.0	48.2	72.0
53'-1/8"	48.2	72.0	48.2	72.0
19'-1/8"	48.2	72.0	48.2	72.0
26'-1/2"	48.2	72.0	48.2	72.0
37"	48.2	72.0	48.2	72.0
45"	48.2	72.0	48.2	72.0
53'-1/8"	48.2	72.0	48.2	72.0
19'-1/8"	48.2	72.0	48.2	72.0
26'-1/2"	48.2	72.0	48.2	72.0
37"	48.2	72.0	48.2	72.0
45"	48.2	72.0	48.2	72.0
53'-1/8"	48.2	72.0	48.2	72.0
19'-1/8"	48.2	72.0	48.2	72.0
26'-1/2"	48.2	72.0	48.2	72.0
37"	48.2	72.0	48.2	72.0
45"	48.2	72.0	48.2	72.0
53'-1/8"	48.2	72.0	48.2	72.0

() NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB

SERIES 910 ALUMINUM SINGLE HUNG WDW.

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ABOVE.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.

LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY. ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.


MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT, AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.	GLASS TYPE 'A'	GLASS TYPE 'B'	GLASS TYPE 'C'	
HEIGHT	EXT.(+)	INT.(+)	EXT.(+)	INT.(+)
24"	48.2	72.0	48.2	72.0
30"	48.2	72.0	48.2	72.0
36"	48.2	72.0	48.2	72.0
42"	48.2	72.0	48.2	72.0
48"	48.2	72.0	48.2	72.0
54"	48.2	72.0	48.2	72.0
60"	48.2	72.0	48.2	72.0
66"	48.2	72.0	48.2	72.0
72"	48.2	72.0	48.2	72.0
78"	48.2	72.0	48.2	72.0
84"	48.2	72.0	48.2	72.0
90"	48.2	72.0	48.2	72.0
96"	48.2	72.0	48.2	72.0
102"	48.2	72.0	48.2	72.0
108"	48.2	72.0	48.2	72.0
114"	48.2	72.0	48.2	72.0
120"	48.2	72.0	48.2	72.0
126"	48.2	72.0	48.2	72.0
132"	48.2	72.0	48.2	72.0
138"	48.2	72.0	48.2	72.0
144"	48.2	72.0	48.2	72.0
150"	48.2	72.0	48.2	72.0
156"	48.2	72.0	48.2	72.0
162"	48.2	72.0	48.2	72.0
168"	48.2	72.0	48.2	72.0
174"	48.2	72.0	48.2	72.0
180"	48.2	72.0	48.2	72.0
186"	48.2	72.0	48.2	72.0
192"	48.2	72.0	48.2	72.0
198"	48.2	72.0	48.2	72.0
204"	48.2	72.0	48.2	72.0
210"	48.2	72.0	48.2	72.0
216"	48.2	72.0	48.2	72.0
222"	48.2	72.0	48.2	72.0
228"	48.2	72.0	48.2	72.0
234"	48.2	72.0	48.2	72.0
240"	48.2	72.0	48.2	72.0
246"	48.2	72.0	48.2	72.0
252"	48.2	72.0	48.2	72.0
258"	48.2	72.0	48.2	72.0
264"	48.2	72.0	48.2	72.0
270"	48.2	72.0	48.2	72.0
276"	48.2	72.0	48.2	72.0
282"	48.2	72.0	48.2	72.0
288"	48.2	72.0	48.2	72.0
294"	48.2	72.0	48.2	72.0
300"	48.2	72.0	48.2	72.0
306"	48.2	72.0	48.2	72.0
312"	48.2	72.0	48.2	72.0
318"	48.2	72.0	48.2	72.0
324"	48.2	72.0	48.2	72.0
330"	48.2	72.0	48.2	72.0
336"	48.2	72.0	48.2	72.0
342"	48.2	72.0	48.2	72.0
348"	48.2	72.0	48.2	72.0
354"	48.2	72.0	48.2	72.0
360"	48.2	72.0	48.2	72.0
366"	48.2	72.0	48.2	72.0
372"	48.2	72.0	48.2	72.0
378"	48.2	72.0	48.2	72.0
384"	48.2	72.0	48.2	72.0
390"	48.2	72.0	48.2	72.0
396"	48.2	72.0	48.2	72.0
402"	48.2	72.0	48.2	72.0
408"	48.2	72.0	48.2	72.0
414"	48.2	72.0	48.2	72.0
420"	48.2	72.0	48.2	72.0
426"	48.2	72.0	48.2	72.0
432"	48.2	72.0	48.2	72.0
438"	48.2	72.0	48.2	72.0
444"	48.2	72.0	48.2	72.0
450"	48.2	72.0	48.2	72.0
456"	48.2	72.0	48.2	72.0
462"	48.2	72.0	48.2	72.0
468"	48.2	72.0	48.2	72.0
474"	48.2	72.0	48.2	72.0
480"	48.2	72.0	48.2	72.0
486"	48.2	72.0	48.2	72.0
492"	48.2	72.0	48.2	72.0
498"	48.2	72.0	48.2	72.0
504"	48.2	72.0	48.2	72.0
510"	48.2	72.0	48.2	72.0
516"	48.2	72.0	48.2	72.0
522"	48.2	72.0	48.2	72.0
528"	48.2	72.0	48.2	72.0
534"	48.2	72.0	48.2	72.0
540"	48.2	72.0	48.2	72.0
546"	48.2	72.0	48.2	72.0
552"	48.2	72.0	48.2	72.0
558"	48.2	72.0	48.2	72.0
564"	48.2	72.0	48.2	72.0
570"	48.2	72.0	48.2	72.0
576"	48.2	72.0	48.2	72.0
582"	48.2	72.0	48.2	72.0
588"	48.2	72.0	48.2	72.0
594"	48.2	72.0	48.2	72.0
600"	48.2	72.0	48.2	72.0
606"	48.2	72.0	48.2	72.0
612"	48.2	72.0	48.2	72.0
618"	48.2	72.0	48.2	72.0
624"	48.2	72.0	48.2	72.0
630"	48.2	72.0	48.2	72.0
636"	48.2	72.0	48.2	72.0
642"	48.2	72.0	48.2	72.0
648"	48.2	72.0	48.2	72.0
654"	48.2	72.0	48.2	72.0
660"	48.2	72.0	48.2	72.0
666"	48.2	72.0	48.2	72.0
672"	48.2	72.0	48.2	72.0
678"	48.2	72.0	48.2	72.0
684"	48.2	72.0	48.2	72.0
690"	48.2	72.0	48.2	72.0
696"	48.2	72.0	48.2	72.0
702"	48.2	72.0	48.2	72.0
708"	48.2	72.0	48.2	72.0
714"	48.2	72.0	48.2	72.0
720"	48.2	72.0	48.2	72.0
726"	48.2	72.0	48.2	72.0
732"	48.2	72.0	48.2	72.0
738"	48.2	72.0	48.2	72.0
744"	48.2	72.0	48.2	72.0
750"	48.2	72.0	48.2	72.0
756"	48.2	72.0	48.2	72.0
762"	48.2	72.0	48.2	72.0
768"	48.2	72.0	48.2	72.0
774"	48.2	72.0	48.2	72.0
780"	48.2	72.0	48.2	72.0
786"	48.2	72.0	48.2	72.0
792"	48.2	72.0	48.2	72.0
798"	48.2	72.0	48.2	72.0
804"	48.2	72.0	48.2	72.0
810"	48.2	72.0	48.2	72.0
816"	48.2	72.0	48.2	72.0
822"	48.2	72.0	48.2	72.0
828"	48.2	72.0	48.2	72.0
834"	48.2	72.0	48.2	72.0
840"	48.2	72.0	48.2	72.0
846"	48.2	72.0	48.2	72.0
852"	48.2	72.0	48.2	72.0
858"	48.2	72.0	48.2	72.0
864"	48.2	72.0	48.2	72.0
870"	48.2	72.0	48.2	72.0
876"	48.2	72.0	48.2	72.0
882"	48.2	72.0	48.2	72.0
888"	48.2	72.0	48.2	72.0
894"	48.2	72.0	48.2	72.0
900"	48.2	72.0	48.2	72.0
906"	48.2	72.0	48.2	72.0
912"	48.2	72.0	48.2	72.0
918"	48.2	72.0	48.2	72.0
924"	48.2	72.0	48.2	72.0
930"	48.2	72.0	48.2	72.0
936"	48.2	72.0	48.2	72.0
942"	48.2	72.0	48.2	72.0
948"	48.2	72.0	48.2	72.0
954"	48.2	72.0	48.2	72.0
960"	48.2	72.0	48.2	72.0
966"	48.2	72.0	48.2	72.0
972"	48.2	72.0	48.2	72.0
978"	48.2	72.0	48.2	72.0
984"	48.2	72.0	48.2	72.0
990"	48.2	72.0	48.2	72.0
996"	48.2	72.0	48.2	72.0
1002"	48.2	72.0	48.2	72.0
1008"	48.2	72.0	48.2	72.0
1014"	48.2	72.0	48.2	72.0
1020"	48.2	72.0	48.2	72.0
1026"	48.2	72.0	48.2	72.0
1032"	48.2	72.0	48.2	72.0
1038"	48.2	72.0	48.2	72.0
1044"	48.2	72.0	48.2	72.0
1050"	48.2	72.0	48.2	72.0
1056"	48.2	72.0	48.2	72.0
1062"	48.2	72.0	48.2	72.0
1068"	48.2	72.0	48.2	72.0
1074"	48.2	72.0	48.2	72.0
1080"	48.2	72.0	48.2	72.0
1086"	48.2	72.0	48.2	72.0
1092"	48.2	72.0	48.2	72.0
1098"	48.2	72.0	48.2	72.0
1104"	48.2	72.0	48.2	72.0
1110"	48.2	72.0	48.2	72.0
1116"	48.2	72.0	48.2	72.0
1122"	48.2	72.0	48.2	72.0
1128"	48.2	72.0	48.2	72.0
1134"	48.2	72.0	48.2	72.0
1140"	48.2	72.0	48.2	72.0
1146"	48.2	72.0	48.2	72.0
1152"	48.2	72.0	48.2	72.0
1158"	48.2	72.0	48.2	72.0
1164"	48.2	72.0	48.2	72.0
1170"	48.2	72.0	48.2	72.0
1176"	48.2	72.0	48.2	72.0
1182"	48.2	72.0	48.2	72.0
1188"	48.2	72.0	48.2	7


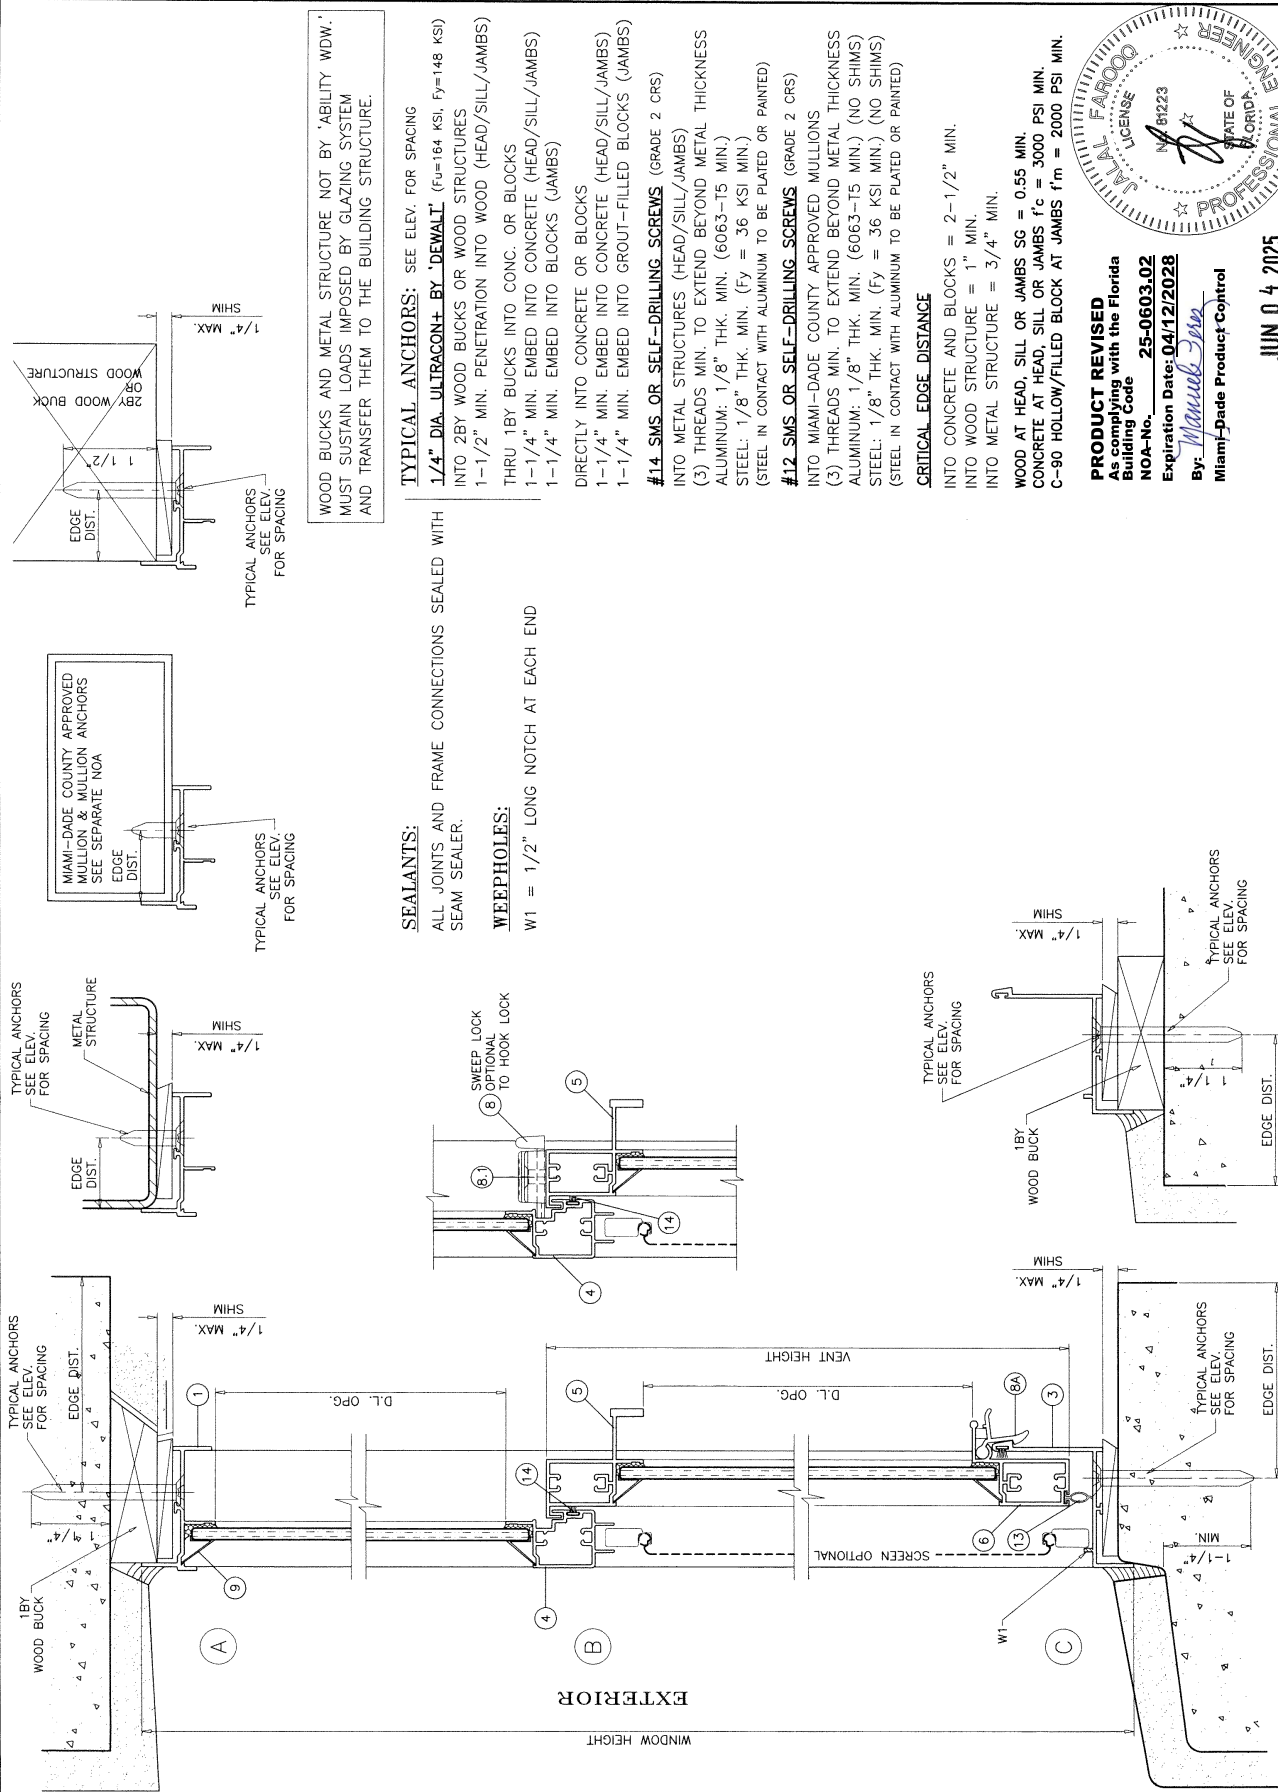


A circular professional engineer seal for the State of Florida. The outer ring contains the text "JALAL FAROOQ" at the top and "PROFESSIONAL ENGINEER" at the bottom, separated by two stars. The inner circle contains the text "LICENSE" on the left and "STATE OF FLORIDA" on the right, also separated by two stars. In the center, the license number "NO. 61223" is printed above a stylized signature.

PRODUCT REVISED
As complying with the Florida
Building Code
NNOA-No. **25-0603.02**
Expiration Date: **04/12/2028**
By: Manuel Jara
Miami-Dade Product Control

JUN 04 2025

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	GW-31798	1	FRAME HEAD	6063-T6	-
2	TW-117	2	FRAME JAMB	6063-T6	-
3	TW-114	1	FRAME SILL	6063-T6	-
4	GW-36123	1	FIXED MTG. RAIL	6063-T6	-
5	TW-113	1	STD. VENT TOP RAIL	6063-T6	-
6	TW-112	1	VENT BOTTOM RAIL	6063-T6	-
7	GW-31802	2	VENT JAMB	6063-T6	-
8	TW-115	2/VENT	SWEEP LOCK @ 9" FROM ENDS	6063-T6	-
8.1	#8 X 3/4"	2/LOCK	LOCK FASTENERS	ST STEEL	FH SMS
8A	-	2/VENT	SPRING LOADED HOOK LOCK @ 6" FROM ENDS	6063-T6	-
9	05-273	AS REQD.	ROLL FORMED GLAZING BEAD	ALUMINUM	-
10	-	2	VENT STOP (5-1/4" LONG)	ALUMINUM	-
11	-	2	SPIRAL BALANCE	-	CALDWELL
12	-	4	VENT GUIDE	PLASTIC	-
13	AV-0529	AS REQD.	BULB WEATHERSTRIP	VINYL	AMERICAN VINYL CO.
14	W23231	AS REQD.	FIN SEAL PILE WEATHERSTRIP	WOOL	ULTRAFAB
16	#10 X 1"	AS REQD.	FRAME/VENT ASSEMBLY SCREWS	CRS	PH SMS
17	-	AS REQD.	SETTING BLOCKS AT 1/4" POINTS	EPDM	DUROMETER 80+5 SHORE A

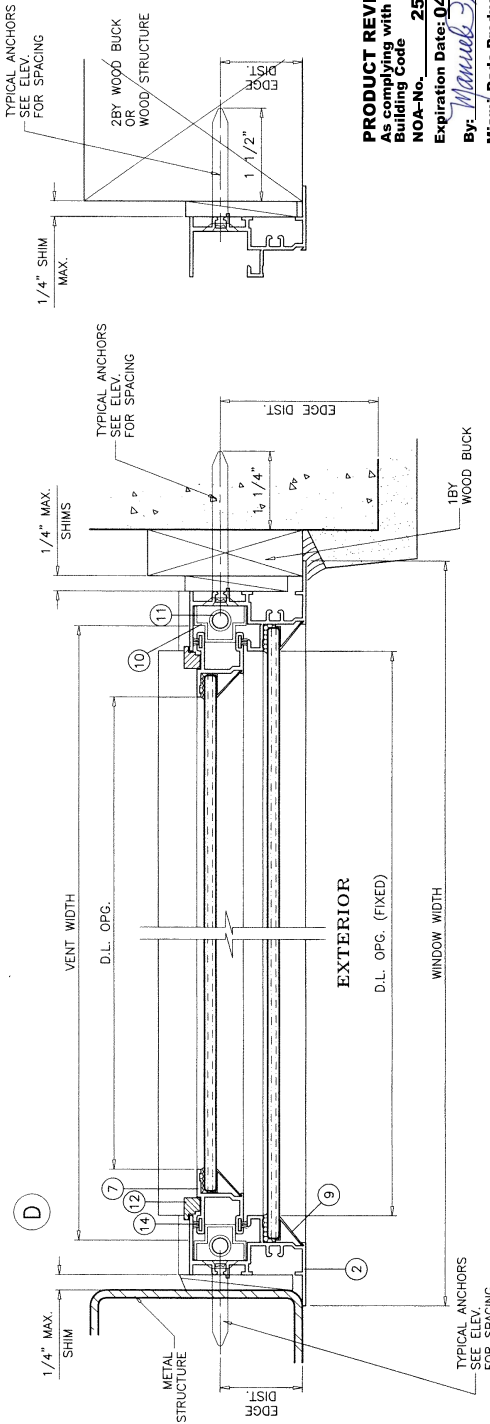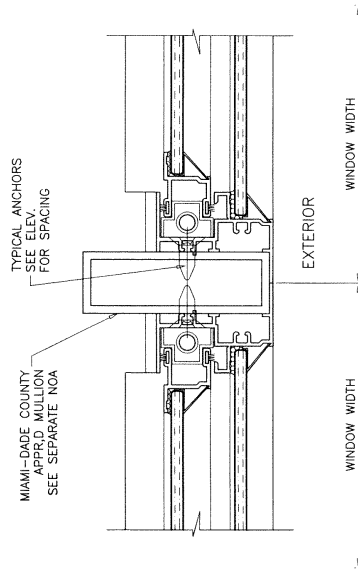

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. 25-0603.02
Expiration Date: 04/12/2028
By: *Manuel Jara*
Miami-Dade Product Control

JAMAL FAROOQ
LICENSE
No. 81223
STATE OF FLORIDA
PROFESSIONAL ENGINEER

JUN 04 2025

